


DAYLIFF

DE

End Suction Centrifugal Pumps

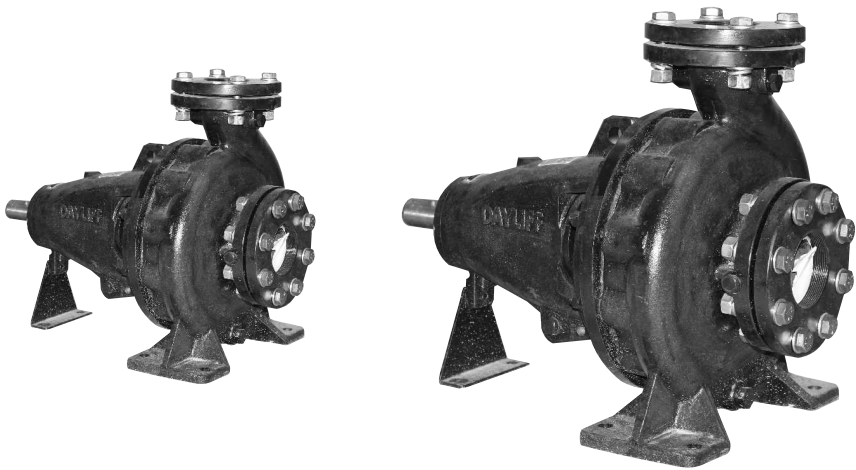


Installation & Operating Manual

INDEX

1. PUMP SPECIFICATIONS	1
2. MOUNTING	3
3. INSTALLATION	4
4. PUMP OPERATION	5
5. TROUBLE SHOOTING	6
6. WARRANTY	7

Thank you for choosing Dayliff DE pump. The pump has been manufactured to the highest standards and if operated correctly should give many years of efficient and trouble free service. Careful reading of this instruction manual is therefore extremely important and if you have any queries please refer them to your retailer.

1. PUMP SPECIFICATIONS

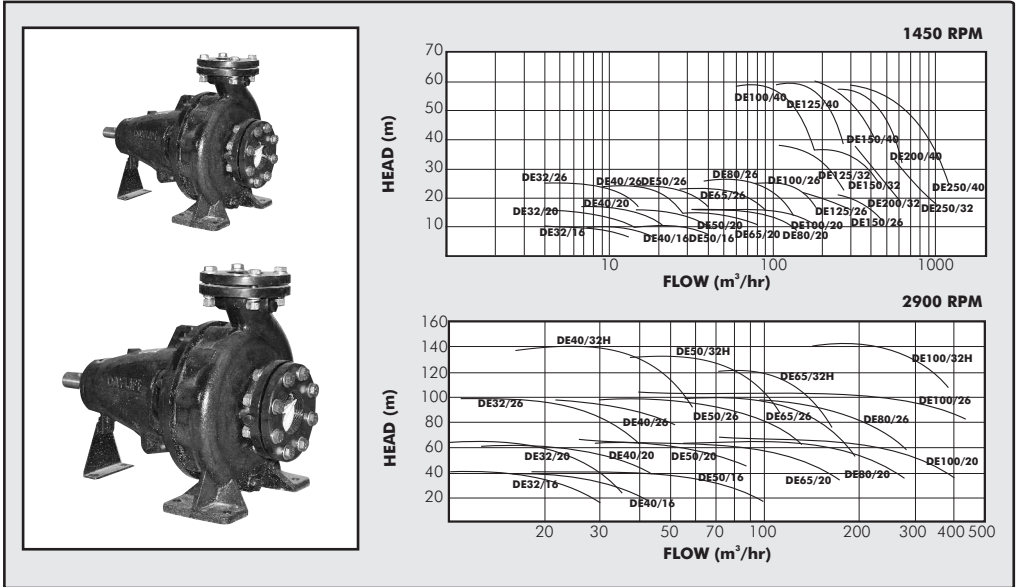

The **Dayliff DE** range of end suction centrifugal pumps are rugged heavy-duty pumps designed for various water supply, irrigation and fire fighting duties in agricultural, commercial and industrial applications. The pumps feature gland packing seal for simple and economic maintenance, back pullout design enabling removal of the rotating element without disturbing the pipework connections and heavy duty bearings.

A wide range is available and pumps can be modified for specific duties by adjustment of the impeller diameter which must be done with reference to the particular pump curve.




Motors should be selected according to the pump speed and impeller diameter and mounted together with the pumps on a base frame with coupling. The pumps are also suitable for belt drive by either electric motor or a diesel engine.

Pump construction is heavy duty cast iron casing with stainless steel shaft and bronze impeller

Max Operating Pressure: 16Bar **Temp Range:** -10°C to +105°C

Pump Dimension


MODEL	SHAFT MODULE	DISCHARGE	SUCTION	FULL IMPELLER MAX POWER ABSORBED (kW)		DIMENSIONS (mm)					NET WEIGHT (kgs)
				1450rpm	2900rpm	a	f	h1	h2	n1	
DE32/16	25	32	50	0.5	4.5	80	360	132	160	240	35
DE32/20	25	32	50	1	9	80	360	160	180	240	47
DE32/26	25	32	50	2.2	19	100	360	180	225	320	58
DE40/16	25	40	65	0.75	5.5	80	360	132	160	240	34
DE40/20	25	40	65	1.2	9.2	100	360	160	180	265	45
DE40/26	25	40	65	2.5	22	100	360	180	225	320	61
DE40/32H	35	40	65	-	48	125	470	200	250	345	101
DE50/16	25	40	65	1.5	11	100	360	160	180	265	39
DE50/20	25	40	65	2.2	18	100	360	160	200	265	49
DE50/26	25	40	65	4.5	40	100	360	180	225	320	68
DE50/32H	35	40	65	-	70	125	470	180	280	345	105
DE65/20	25	65	80	4	48	100	360	180	225	320	55
DE65/26	35	65	80	5.5	55	100	470	200	250	360	87
DE65/32H	35	65	80	-	85	125	470	225	280	400	111
DE80/20	35	80	100	5.5	50	125	470	225	250	345	76
DE80/26	35	80	100	10	75	125	470	200	280	400	95
DE100/20	35	100	125	7.5	55	125	470	200	280	360	84
DE100/26	35	100	125	15	130	140	470	225	280	400	102
DE100/32H	35	125	100	-	175	140	470	250	315	400	134
DE100/40	45	125	100	40		140	470	280	355	500	174
DE125/26	35	150	125	24		140	530	250	355	400	115
DE125/32	45	150	125	31		140	530	280	355	500	163
DE125/40	45	150	125	60		140	530	315	400	500	181
DE150/26	45	200	150	27		160	530	250	355	450	148
DE150/32	45	200	150	50		160	530	280	400	550	170
DE150/40	45	200	150	76		160	530	315	450	550	209
DE200/32	55	250	200	60		180	670	315	480	600	251
DE200/40	55	250	200	125		180	670	335	480	600	295
DE250/32	55	300	250	83		220	691	335	520	660	311
DE250/40	55	300	250	129		220	682	400	560	660	390



2. MOUNTING

Prime Mover Selection: It is essential to ensure correct prime mover selection as the pump unit will be inefficient if over sized and will overload if undersized. The power absorbed at the duty point should be read from the pump curve and an appropriately sized prime mover selected that allows for some spare power capacity (recommended 15%) to accommodate efficiency reductions as the installations ages. Care should also be taken to de-rate engines for altitude and temperature. Full pump details are given in the detailed pump curves available on www.dayliff.com. Also full system application curves and optimal pump selection is available using DayPro selection tool accessories through the pump supplier.

Direct coupled units: Units should be direct coupled if possible. Mounting frames should be rigid to prevent flexing during operation. The pump and prime mover should be connected with a flexible coupling and great care must be taken to ensure axial and horizontal alignment. Pump sets must be tested to check for misalignment vibration before installation.

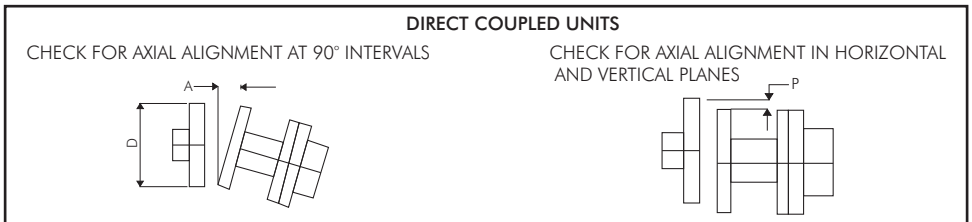

Belt Drive Units: Where the pump and prime mover (usually an engine) need to rotate at different speeds pulley drive can be used. In these cases a jack shaft mounted on plumber blocks is necessary to avoid radial loads on the pump shaft and generally a similar arrangement should be used for the engine. Pulley sizes should be selected to give the correct unit speeds and manufacturer's data should be used to select a belt arrangement to prevent overloading. Correct alignment is also important.

Provision should be made for prime mover movement for belt tensioning, which should not be over tensioned as the additional loads will cause equipment damage.




All external moving parts including coupling, pulleys, belts and shafts must be fitted with enclosing guards.

3. INSTALLATION

Location: The pump should be installed as near as possible to the water and as a general rule the suction lift should be minimised to ensure maximum pumping efficiency.

Foundation: To be sufficiently substantial to support the pump independently of piping and provide sufficient support to eliminate mounting bedplate distortion. For engine drive sets the foundation should be substantial to absorb the engine vibrations.

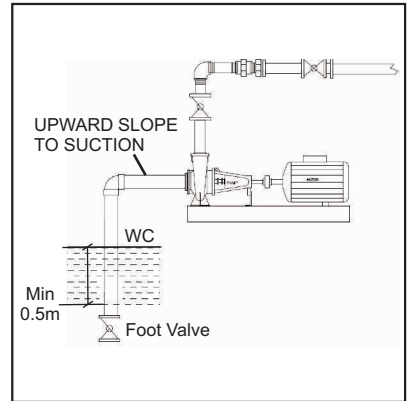

An effective suction installation is essential for efficient pump operation. most pump operating problems are due to inappropriate suction arrangements.

Pipe Supports: Piping should be supported independently near the pump. Pipe loads on the pump flanges must be avoided.

Suction Lift: In the case of negative suction installations the suction lift, which should be the sum of the vertical lift, the suction line friction losses, vapour pressure for water above 30°C and a safety margin of 2m must always be less than the given NPSH required by the pump at the rated flow. Refer to the pump curve for NPSH required.

Suction Pipe: The suction pipe must be absolutely airtight as even small leaks will impair or stop pump operation. A pipe size larger than the pump connection is recommended and tapered eccentric connectors should be used for changes in pipe diameter. The suction line should be as short and direct as possible and sharp turns should be avoided by using long radius bends and not elbows.

When laying the pipe line maintain a uniform gradient rising towards pump for the whole distance. Avoid air pockets, humps or depressions in the pipe line (even if the pump is below supply level) which may trap air and impair performance.

Ensure the end of the suction line is sufficiently below the water surface to prevent vortexing (recommended 50 cms). The line must be free from pipe scale, welding beads or any loose particles that could damage the pump when operating.

4. PUMP OPERATION

Gland Packing: A gland packing must drip during normal operation to ensure shaft lubrication. To adjust gland stud nuts should be finger tight when the pump is first started. After start-up allow time for the packing to settle, then adjust leakage rate by tightening the nuts one flat at a time giving time to settle with each adjustment. The leakage rates should be about 20 drops per minute.

Lubrication: Ball bearings require no initial lubrication but should be greased every 2000 hours of running, annually or immediately prior to operating after a long period of idleness. Apply about two strokes from an average grease gun on the bearing housing grease nipple, though ensure not to over grease.

Pump Starting:

On Initial start up or after maintenance;

- Close discharge gate valve.
- Eliminate all air from the pump and suction pipe by priming through the priming tee.
- Air trapped in the casing and impeller can be removed by rotation of pump shaft during filling. In positive suction installations unscrewing the vent plug facilitates priming.
- Start the pump and check for correct rotation (clockwise viewed from the driving end).
- Slowly open discharge gate valve.
- Check the gland packing is dripping correctly (see above)
- Noise

Normal operation:

As for initial starting, except that the air elimination operation may not be required if the pump is adequately primed, though discharge should always be checked for normal flow.



Mains power to the motor must always be disconnected when any maintenance or adjustments are being carried out.

5. TROUBLE SHOOTING

PROBLEM

POSSIBLE CAUSE

SOLUTION

No flow	New Installation	
	Discharge head too high	Check both the static and friction head
	Suction lift too great	Check sufficient new positive suction head available
	Old Installation	
	Suction line and pump housing not properly primed	See Pump Starting
	Impeller, suction pipe or foot valve clogged	Rectify condition
Air leak in suction line	Rectify condition	
Packing worn allowing to leak into pump	Replace packing	
Low flow	Check all the possibilities described for no flow	
	Foot valve and suction piping too small or too long	Change piping
	Wrong direction of rotation	Change motor connections
Motor overload	Undersized motor	Check pump curve for power required
	Flow too great due to total head being lower than anticipated	Reduce flow by restricting discharge gate valve or reduce the impeller diameter
	Mechanical friction due to impeller fouling the pump casing, bent shaft, pump and motor out of alignment; gland packing too tight, low voltage	Rectify condition
Noisy operation	Insufficient NPSH available causing cavitation	Change suction arrangement
	Mechanical damage	Check for bent shaft, loose impeller shaft, worn bearings, pump and motor out of alignment
Hot bearings	Most bearings are capable of withstanding a moderate temperature rise above ambient	
	If temperature is excessive	Check for over greased bearing housing, misaligned coupling, drive belts misaligned or too tight

6. TERMS OF WARRANTY

i) General Liability

- In lieu of any warranty, condition or liability implied by law, the liability of Davis & Shirliff (hereafter called the Company) in respect of any defect or failure of equipment supplied **is limited to making good by replacement or repair** (at the Company's discretion) defects which under proper use appear therein and arise solely from faulty design, materials or workmanship within a specified period. This period commences **immediately after the equipment has been delivered to the customer** and at its termination all liability ceases. Also the warranty period will be assessed **on the basis of the date that the Company is informed of the failure**.
- This warranty applies solely to equipment supplied and **no claim for consequential damages**, however arising, will be entertained. Also the warranty specifically excludes defects caused by fair wear and tear, the effects of careless handling, lack of maintenance, faulty installation, incompetence on the part of the equipment user, Acts of God or any other cause beyond the Company's reasonable control. Also, any repair or attempt at repair carried out by any other party **invalidates all warranties**.

ii) Standard Warranty

General Terms

If equipment failure occurs in the normal course of service having been competently installed and when operating within its specified duty limits warranty will be provided as follows:-

- **Up to two years - The item will be replaced or repaired at no charge.**
- **Over two years, less than three years - The item will be replaced or repaired at a cost to the customer of 50% of the Davis & Shirliff market price.**

The warranty on equipment supplied or installed by others is conditional upon the defective unit **being promptly returned free to a Davis & Shirliff office** and collected thereafter when repaired. No element of site repair is included in the warranty and any site attendance costs will be payable in full at standard chargeout rates. Also proof of purchase including the purchase invoice must be provided for a warranty claim to be considered.

DAYLIFF is a brand of **Davis & Shirliff**

for enquiries contact

Davis & Shirliff, Ltd.

P.O. Box 41762 - 00100, Nairobi, Kenya

Tel: 6968000/ 0711 079 000

or visit

www.dayliff.com

for details of the nearest branch or stockist